


TANK ALERT XT INDOOR/OUTDOOR

TERMINAL BLOCK WIRING FOR ALARM/PUMP CONTROL

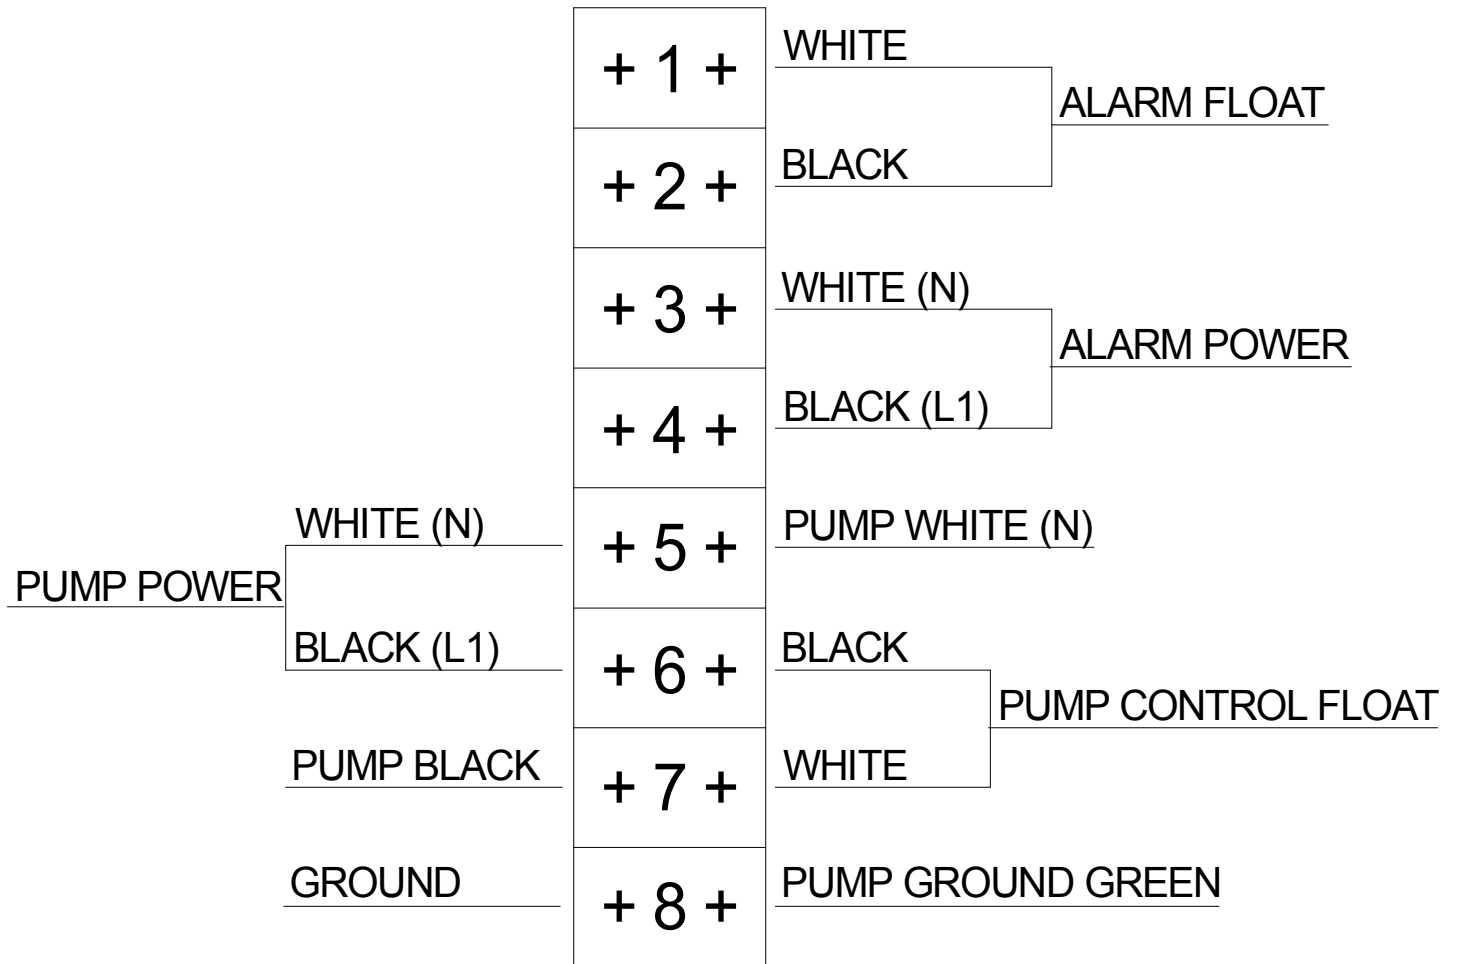

TWO CIRCUIT BREAKERS REQUIRED
ONE BREAKER FOR PUMP
ONE BREAKER FOR ALARM
ELECTRICAL WIRING AND SERVICING OF THIS
PRODUCT MUST BE PERFORMED BY A
LICENSED ELECTRICIAN